



XIOC-NET-DP-M

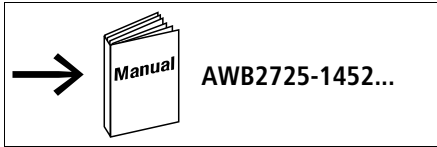

Voraussetzung – Requirements – Configuration require – Requisiti – Requisitos

Hardware – Matériel Software – Logiciel

XC100 ≙ V04	BTS ≙ V3.0
XC200 ≙ V04	BTS ≙ V1.02.00
xSoft ≙ 2.3.2 /Update → www.moeller.net	

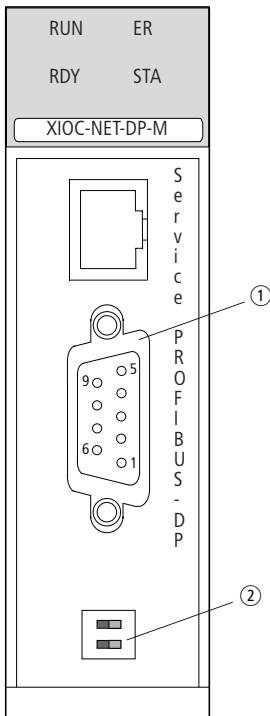


ER: Fehler – Error – Défaut – Errore
RDY: Ready
STA: Status – Affichage – Stato – Estado

→ Das Gerät ist für den industriellen Einsatz geeignet (→ EN 55011/22 Klasse A).
The device is suitable for use in industrial environments (→ EN 55011/22 Class A).
L'appareil a été conçu pour l'emploi en milieu industriel (→ EN 55011/22 classe A).
L'apparecchio è adatto per uso in ambienti industriali (→ EN 55011/22 Classe A).
El aparato es adecuado para uso en ambiente industrial (→ EN 55011/22 clase A).

① PROFIBUS-DP

3	RxD/TxD-P
4	CNTR-P
5	DGND
6	VP (+5 V DC)
8	RxD/TxD-N



- ② Schalter für Busabschlusswiderstände
Switch for the bus terminating resistors
Interrupteur pour résistance de terminaison de bus
Interruptore resistenza di terminazione bus
Interruptor para resistencias del bus

